


Rxdna's Connected At Circuit Breaker Box

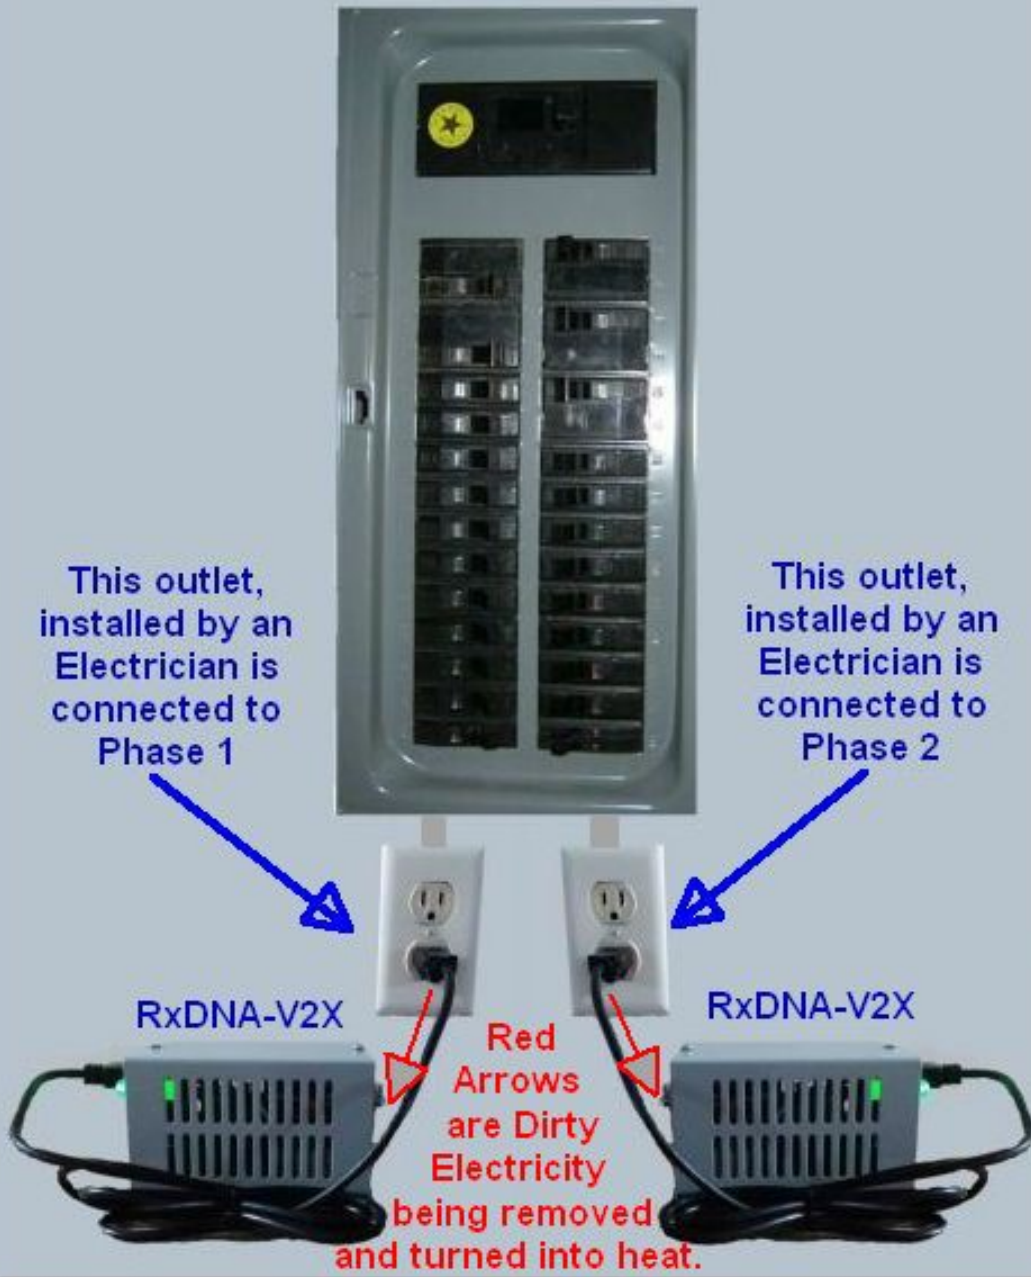

RxDNA-V2X's Connected Indoors When Circuit Breaker Box Is Outdoors

These Indoor Outlets Should Be Connected As Close As Possible To The Place Where The Circuits Enter The Facility, So That Electrically They Are As Close As Possible To The Circuit Breaker Box

This Outlet, Installed By An Electrician, Is Connected To Phase 1

This Outlet, Installed By An Electrician, Is Connected To Phase 2

